

BELL SYSTEM PRACTICES

Station Installation and
Maintenance

ADDENDUM C55.162

Issue A, 2-1-55-N
T. P. T. & T. Co.
Provisional

**TELEPHONE SET
595 TYPE
(DISTANT TALKING SET)**

1. GENERAL


1.01 This provisional addendum is issued to provide information for the field forces pending the receipt of a more detailed practice from the American Company. This addendum should be retained with subsequent issues of the section until notice is given covering its cancellation or reissuance.

1.02 All sets manufactured after November 1954 are wired in accordance with the drawings in this provisional addendum.

ADDENDUM**C55.162**

Page 1

TELEPHONE SET**595 TYPE****(DISTANT TALKING SET)**

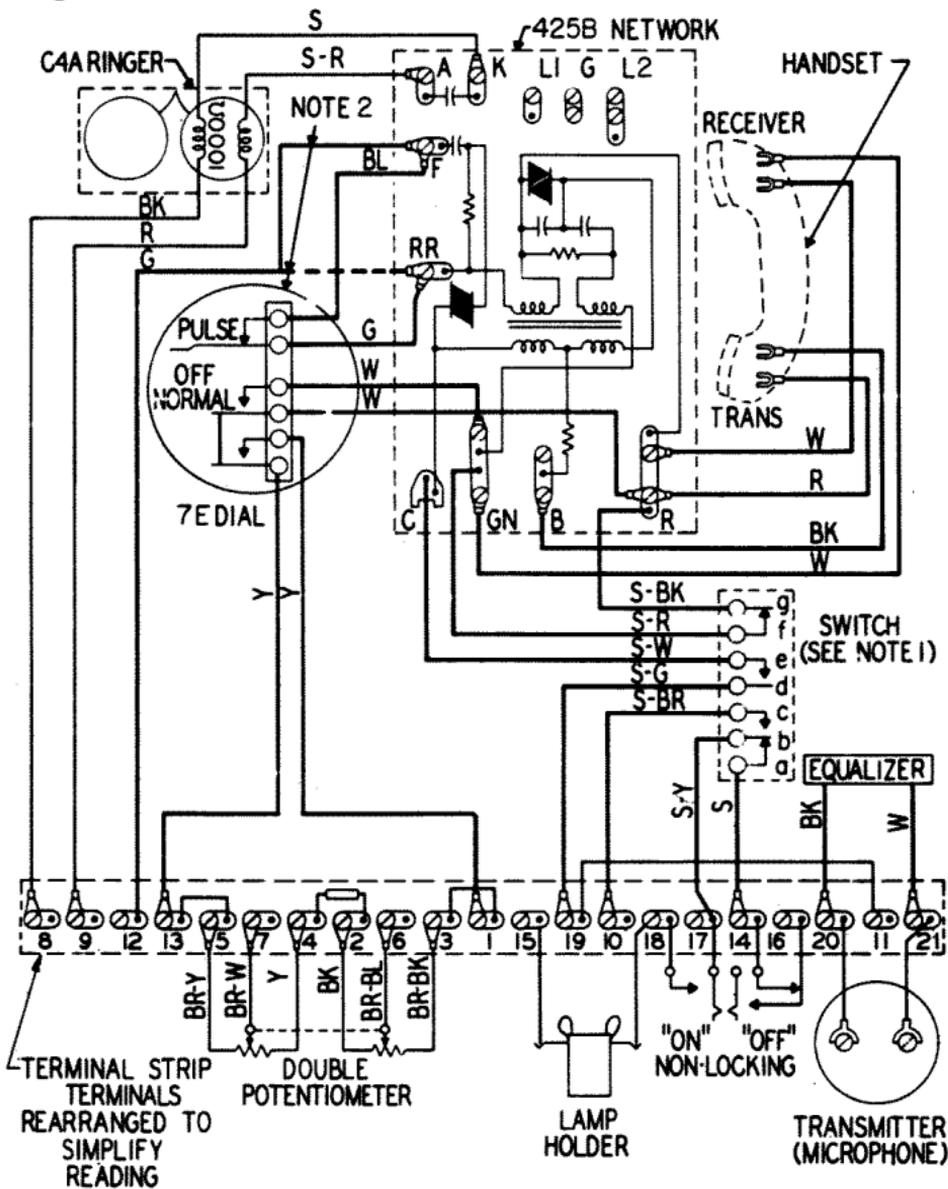

NOTE 1: Contact Sequence

Removing Handset

1. cb closes before de
2. fg opens


Restoring Handset

1. fg closes
2. de opens before cb

NOTE 2: Manual Service

1. Replace dial with 95B-3 apparatus blank.
2. Move green lead from "F" to "RR" on the-network.

**592 A/B-3
Telephone Set Connections**

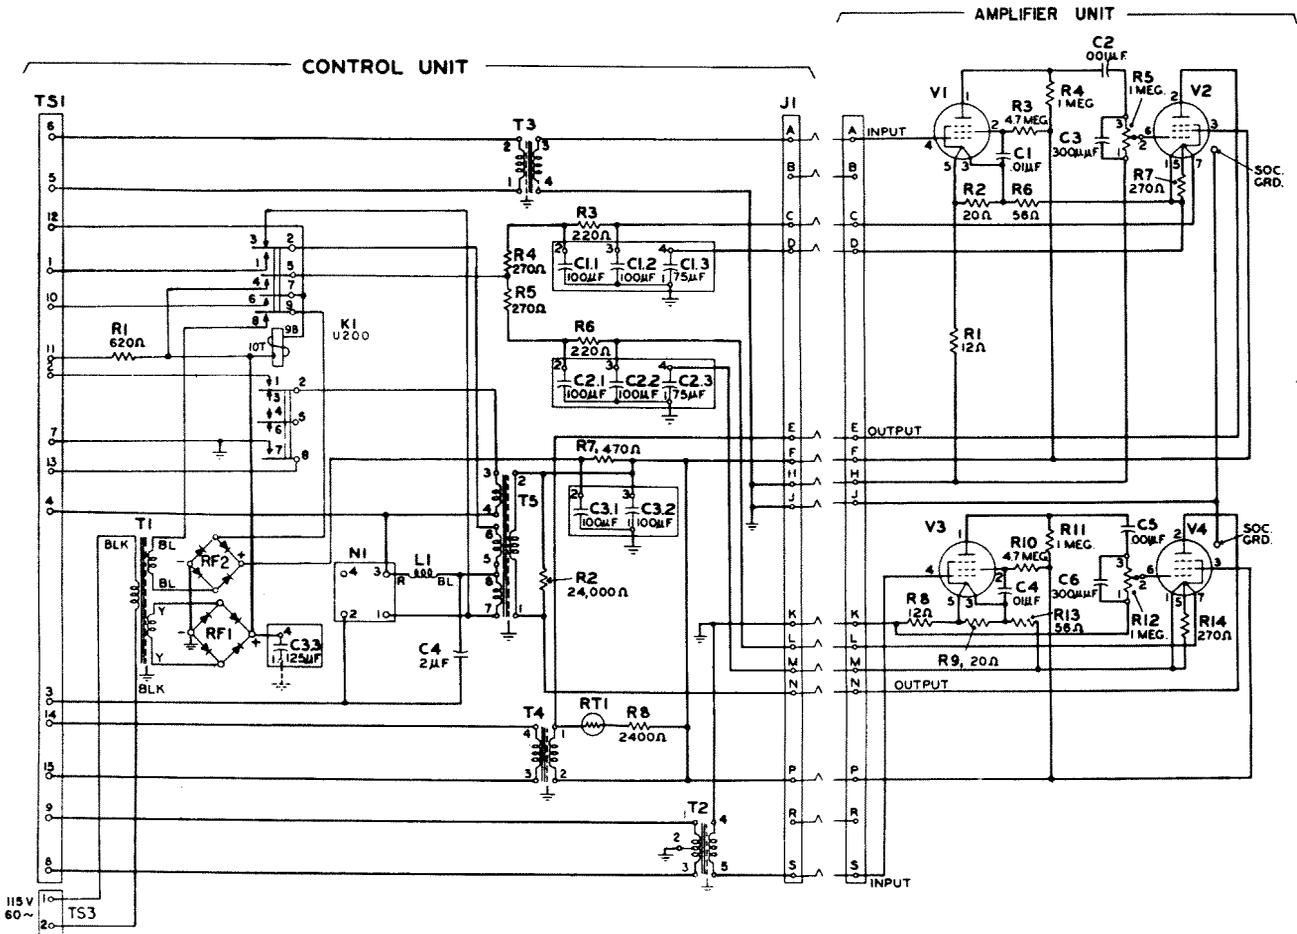

KS-14964

Control Unit with KS-14990 Amplifier Schematic

ADDENDUM


C55.162

Page 3

TELEPHONE SET

595 TYPE

(DISTANT TALKING SET)

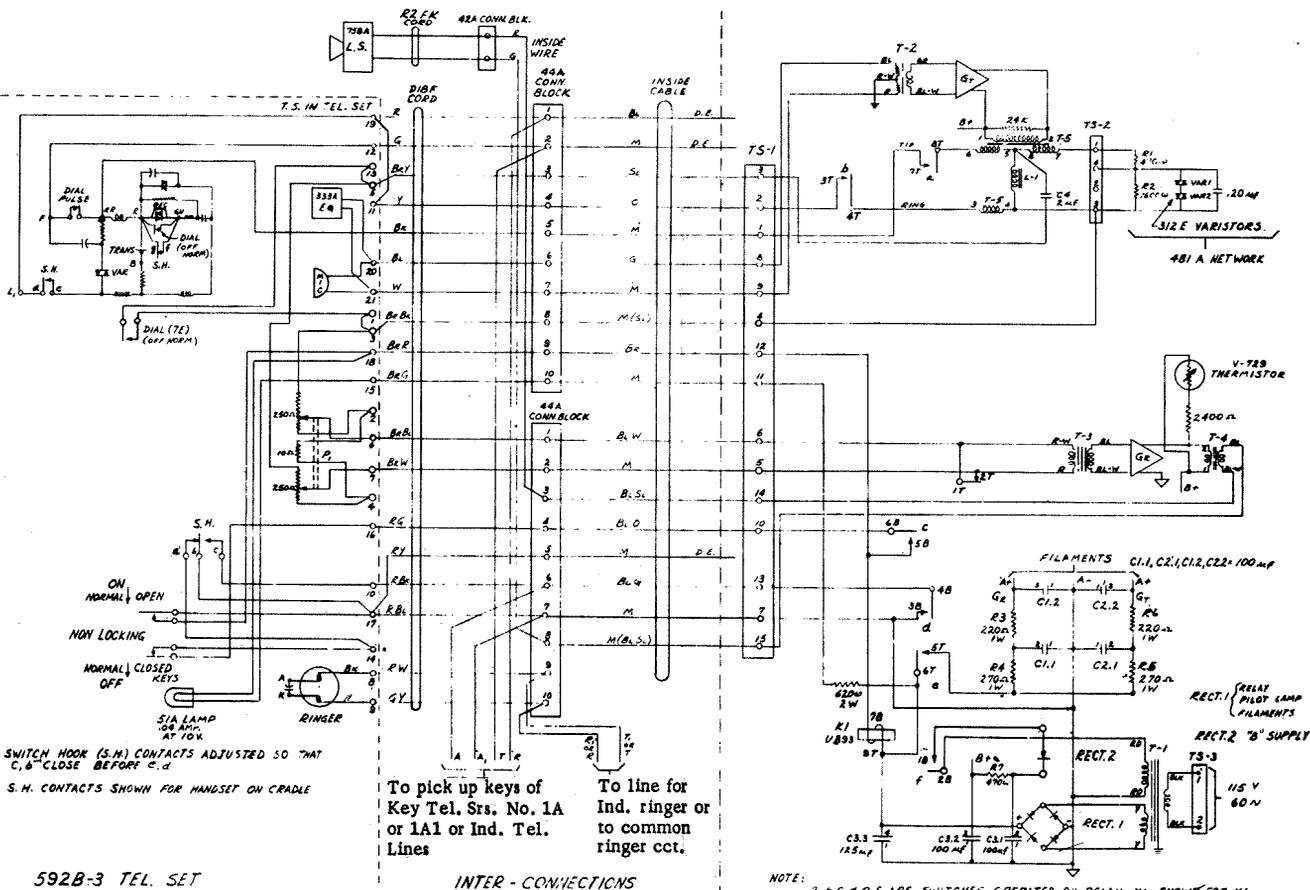

KS-14964-L2 CONTROL UNIT

ADDENDUM
C55.162
Page 4
4 Pages

TELEPHONE SET
595 TYPE
(DISTANT TALKING SET)