

TABLE A-FEATURES											
EQUIPMENT		RAT- ING	LIST OR GROUP	EQUIPMENT OR CIRCUIT DATA					SD EQUIVALENT		
DESCRIPTION	REF NOTE			QTY	EQUIPMENT OR CIRCUIT	L/G OR FIG	WRG	APP	SCHEMATIC	FIG	OPT
WIRING AND APPARATUS REQUIRED FOR CABLE ASSEMBLIES FOR FH-2 L3 FAN LEVEL 36 WITH MFFU L153. (3 FUSES,R SIDE OF CABINET, FANS A/E,B/F,C/G)			8								
WIRING AND APPARATUS REQUIRED FOR CABLE ASSEMBLIES FOR ISLU2 POS 28 WITH 3 LINE SHLFS WITH MFFU L153.			10								
WIRING AND APPARATUS REQUIRED FOR CABLE ASSEMBLIES FOR PSU2 POS 53 WITH MFFU L153.			11								
WIRING AND APPARATUS REQUIRED FOR CABLE ASSEMBLIES FOR IDCU WITH MFFU L153.			13								
WIRING AND APPARATUS REQUIRED FOR CABLE ASSEMBLIES FOR FH-2 L3 FAN LEVEL 36 WITH MFFU L154. (3 FUSES,R SIDE OF CABINET, FANS A/E,B/F,C/G)			20								
WIRING AND APPARATUS REQUIRED FOR CABLE ASSEMBLIES FOR ISLU2 POS 28 WITH 3 LINE SHLFS WITH MFFU L154.			21								
WIRING AND APPARATUS REQUIRED FOR CABLE ASSEMBLIES FOR PSU2 POS 53 WITH MFFU L154.			22								
WIRING AND APPARATUS REQUIRED FOR CABLE ASSEMBLIES FOR IDCU WITH MFFU L154.			24								
WIRING AND APPRATUS REQUIRED FOR CABLE ASSEMBLIES FOR ISLU2 POS 62 WITH TWO LINE SHLFS. WITH MFFU L155.			30								
WIRING AND APPARATUS REQUIRED FOR CABLE ASSEMBLIES FOR MCTU3 POS 36 WITH MFFU 155.			31								
WIRING AND APPARATUS REQUIRED FOR CABLE ASSEMBLIES FOR FH-2 L2 FAN WITH MFFU L155.			32								
TABLE-A CONTINUED											

ISSUE NOTES				
ORIG ISS: 03/08/96		CHANGE CLASS: B		
DRAFT: REW	ENGR: REW	SUPV:	CERTIFIED: 03/08/96	ISSUE: 1

SHEET INDEX										
SHT NBR	A1 THRU A2					ISSUE 1				
ISSUE										
SHT NBR	D1 THRU D2					ISSUE 1				
ISSUE										
SHT NBR	C1	C2	C3	C4	C5					
ISSUE	1	1	1	1	1					
SHT NBR										
ISSUE										
SHT NBR										
ISSUE										
SHT NBR										
ISSUE										
SHT NBR										
ISSUE										
SHT NBR										
ISSUE										
SHT NBR										
ISSUE										
SHT NBR										
ISSUE										
SHT NBR										
ISSUE										

ED5D820-15

AT&T - PROPRIETARY USE PURSUANT TO COMPANY INSTRUCTIONS			
5ESS SWITCHING EQUIPMENT POWER AND ALARM CABLE ASSEMBLIES FOR AIR EXTENSION WNC FOR SMC,LTP CABINETS		RT13	
DWG SIZE C2	ISSUE 1		
AT&T	ED5D820-15	SHEET OF	A1 9

TABLE A-FEATURES (CONTINUED)

EQUIPMENT		EQUIPMENT OR CIRCUIT DATA							SD EQUIVALENT		
DESCRIPTION	REF NOTE	RAT-ING	LIST OR GROUP	QTY	EQUIPMENT OR CIRCUIT	L/G OR FIG	WRG	APP	SCHEMATIC	FIG	OPT
WIRING AND APPARATUS REQUIRED FOR CABLE ASSEMBLIES FOR CSU POS 19 WITH MFFU LIST 155.			33								
WIRING AND APPARATUS REQUIRED FOR CABLE ASSEMBLIES FOR DSU3 POS 11 WITH MFFU L155.			35								
WIRING AND APPARATUS REQUIRED FOR CABLE ASSEMBLIES FOR FH-2 L2 FAN WITH MFFU L156.			40								
WIRING AND APPRATUS REQUIRED FOR CABLE ASSEMBLIES FOR ISLU2 POS 62 WITH TWO LINE SHLFS. WITH MFFU L156.			41								
WIRING AND APPARATUS REQUIRED FOR CABLE ASSEMBLIES FOR MCTU3 POS 36 WITH MFFU 156.			42								
WIRING AND APPARATUS REQUIRED FOR CABLE ASSEMBLIES FOR CSU POS 19 WITH MFFU LIST 156.			44								
WIRING AND APPARATUS REQUIRED FOR CABLE ASSEMBLIES FOR DSU3 POS 11 WITH MFFU L156.			46								

END OF TABLE-A

SEE PROPRIETARY NOTICE ON SHEET ONE

RT13

5ESS SWITCHING EQUIPMENT  
POWER AND ALARM CABLE ASSEMBLIES  
FOR  
AIR EXTENSION WNC  
FOR SMC,LTP CABINETS


DWG SIZE C2 ISSUE 1

ED5D820-15

AT&T

ED5D820-15

SHEET A2 OF 9

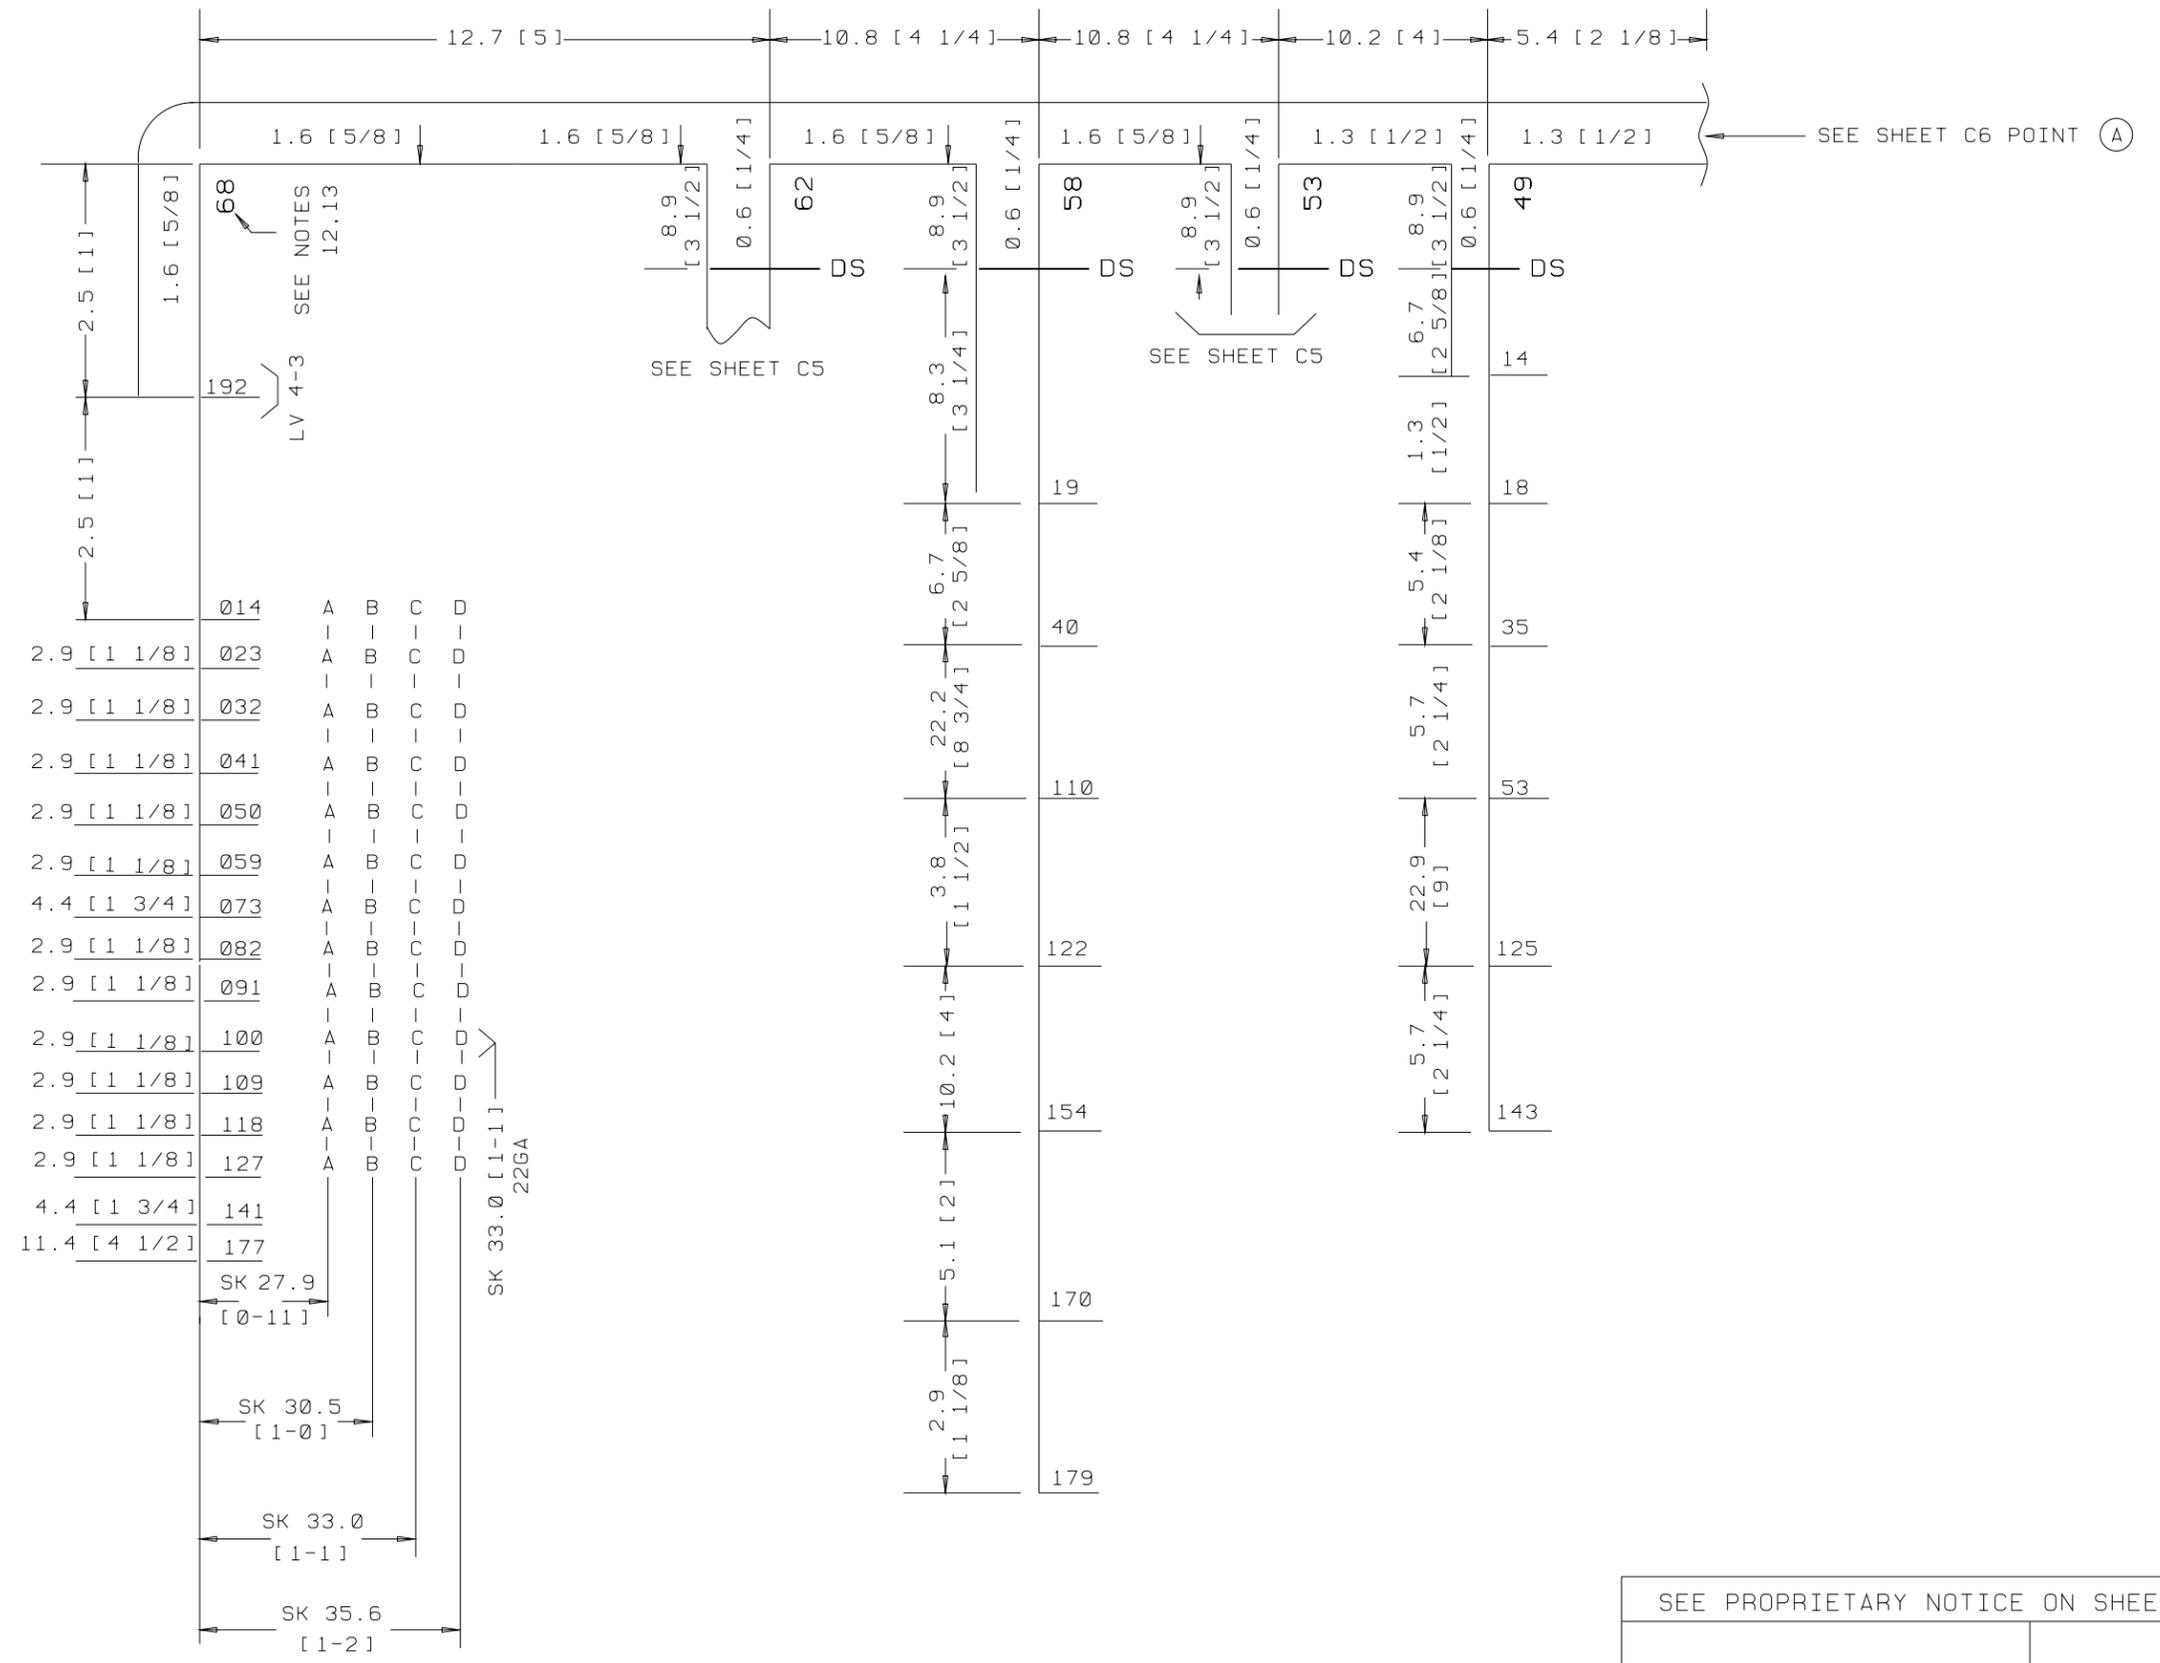

SHEET NOTE:  
 ISLU2 WITH NEW FUSE FILTER  
 J5D003FJ-1



EVEN GROUPS 8, 10, 20, 22, 24, 30, 32, 40, 42, 44 & 46

SEE PROPRIETARY NOTICE ON SHEET ONE		
POWER CABLE ASSEMBLIES	DWG SIZE	ISSUE
	C2	1
AT&T	ED5D820-15	SHEET C1



SEE SHEET C4 POINT A

SHEET NOTE:  
ISLU2 WITH J5D003FJ-1  
FUSE FILTER

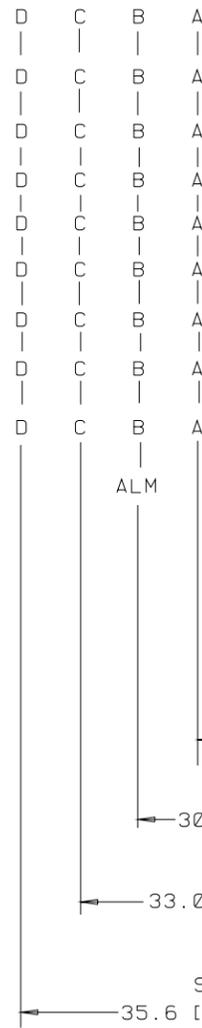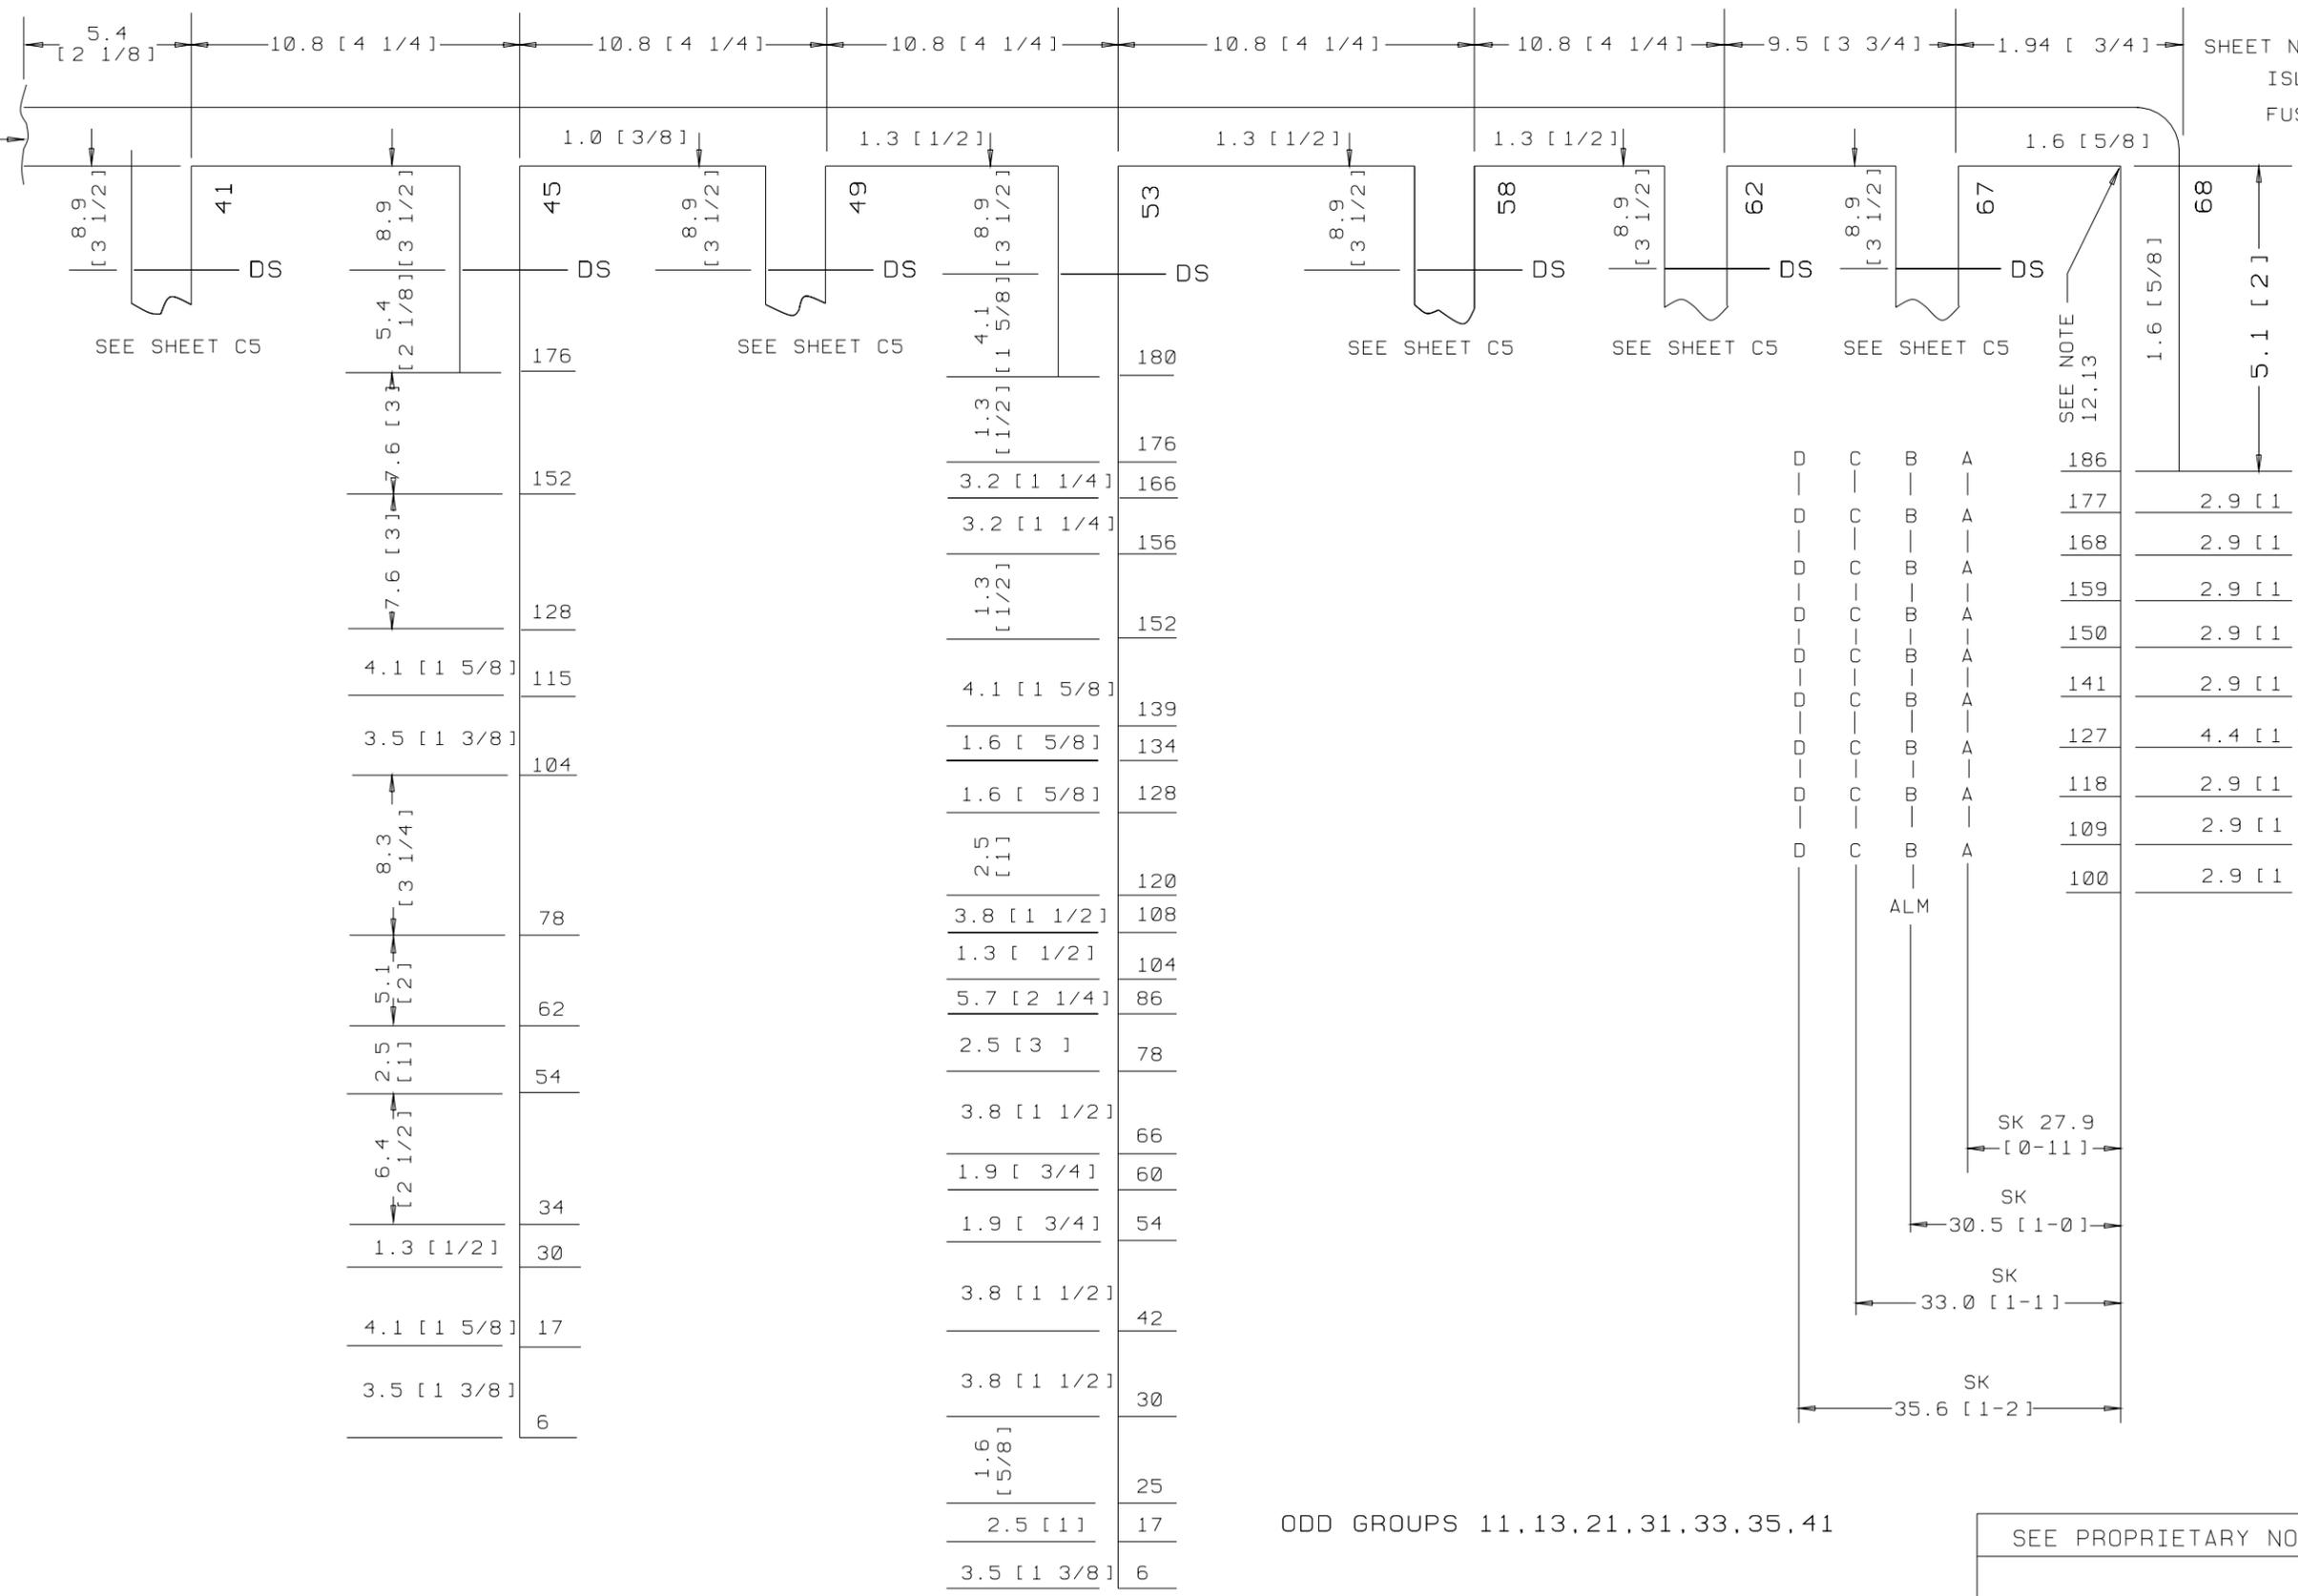

ODD GROUPS 11, 13, 21, 31, 33, 35, 41

SEE PROPRIETARY NOTICE ON SHEET ONE		
POWER CABLE ASSEMBLIES	DWG SIZE	ISSUE
	C2	1
AT&T	ED5D820-15	SHEET C3



0	6	9	10	14	17	20	25	26	29	30	34	39	42	44	52	62	66	75	79	84	100	103	110	115	120	124	130	139	142	144	153	156	162	167	170	175	180	186
1.9 [3/4]	1.0 [3/8]	0.3 [1/8]	1.3 [1/2]	1.0 [3/8]	1.0 [3/8]	1.6 [5/8]	0.3 [1/8]	1.0 [3/8]	0.3 [1/8]	1.3 [1/2]	1.6 [5/8]	1.0 [3/8]	0.6 [1/4]	2.5 [1]	2.9 [1 1/8]	0.6 [1/4]	2.9 [1 1/8]	1.3 [1/2]	1.6 [5/8]	5.1 [2]	1.0 [3/8]	2.2 [7/8]	1.6 [5/8]	1.6 [5/8]	1.3 [1/2]	1.9 [3/4]	2.9 [1 1/8]	0.3 [1/8]	0.6 [1/4]	0.6 [1/4]	1.0 [3/8]	1.9 [3/4]	1.6 [5/8]	1.6 [5/8]	1.0 [3/8]	1.6 [5/8]	1.9 [3/4]	1.9 [3/4]

SK 11.4 [4 1/2] 22GA  
(ARM 67 ONLY)

ODD GROUPS

SK.5314

DS  
100N  
11200

0	9	10	17	19	20	25	26	29	30	34	39	42	44	52	62	66	75	79	84	99	100	103	110	115	120	124	130	139	142	144	153	156	162	167	170	175	180	186
[4/3] 6.1	[8/1] 6.0	[2/1] 6.1	[8/5] 9.1	[8/3] 0.1	[8/5] 9.1	[8/1] 6.1	[4/1] 9.0	[8/1] 3.0	[8/1] 1] 6.2	[4/1] 9.0	[8/5] 9.1	[8/1] 6.1	[8/3] 0.1	[8/1] 6.2	[4/3] 6.1	[8/1] 1] 6.2	[4/1] 9.0	[8/1] 3.0	[4/1] 9.0	[8/1] 3.0	[8/1] 1] 6.2	[4/1] 9.0	[8/5] 9.1	[8/1] 6.1	[8/7] 2.2	[8/5] 9.1	[4/1] 9.0	[4/3] 6.1	[8/1] 1] 6.2	[4/1] 9.0	[4/1] 9.0	[8/1] 3.0	[8/1] 1] 6.2	[4/1] 9.0	[8/5] 9.1	[8/3] 0.1	[8/5] 9.1	[4/3] 6.1

EVEN GROUPS

SD

SEE PROPRIETARY NOTICE ON SHEET ONE		
POWER CABLE ASSEMBLIES	DWG SIZE	ISSUE
	C2	1
AT&T	ED5D820-15	SHEET C5



STOCKLIST

ITEM NBR	LIST GROUP CODE	QTY PER CODE	PRODUCT IDENTIFIER	CODE	DESCRIPTION	REFERENCE POSITION	NOTE	
							SYM	NBR
2500	33,44	10	406918912		RECEPTACLE #41774 AMP INC.			
2600	33,44	10	406639039		TERMINAL, RECEPTACLE #160759-4 POSITIVE LOCK 250 SERIES 20-16 AWG MATERIAL: PHOSPOR BRONZE AMP INC.			
2700	33,44	5	406601062		RECEPTACLE, PARALLEL HOUSING #100100-1 2 CONTACTS, FEMALE, NYLON 6.6 AMP INC.			
2800	33,44	10	900422494		TUBING, HEAT SHRINKABLE #RT876 1/4 IN ID. X 1 IN LG.BK RAYCHEM CORP.			
2900	33,44	1	996340956	KS13385L1	WIRE, GROUND 16 GA, STRANDED, R-R/BK			

\*\*\*\*\* END OF STOCKLIST \*\*\*\*\*

SEE PROPRIETARY NOTICE ON SHEET ONE

RT13

5ESS SWITCHING EQUIPMENT  
POWER AND ALARM CABLE ASSEMBLIES  
FOR  
AIR EXTENSION WNC  
FOR SMC,LTP CABINETS

DWG SIZE  
C2

ISSUE  
1

ED5D820-15

AT&T

ED5D820-15

SHEET D2  
OF 9

PRINTED IN U.S.A.