

SUPPORTING INFORMATION

CATEGORY	NO.
EQUIPMENT DRAWING	J86464L-()
EQUIPMENT DESIGN REQ.	J86464
MAINTENANCE SPEC	167-480-301

DWG ISSUE	REV OR CD	DATE ISSUED	BY	CHKD	APPD
1	1	10-23-61	WAS	WAS	WAS
2A	2A	4-12-62	WAS	WAS	WAS
3D	3D-APP 1D	11-25-65	J.K.	J.K.	J.K.
4B	3D-APP 2B	2-17-65	J.K.	J.K.	J.K.
5D	4D	8-25-65	J.K.	J.K.	J.K.
6B	5B	7-21-65	J.K.	J.K.	J.K.
7B	5B-APP 1B	1-31-67	J.K.	J.K.	J.K.

CIRCUIT NOTES:

DESIG	FUSE AMP	POTENTIAL	ONE PER
TTA	1-1/3	-48	CKT
TTB	1-1/3	-48	CKT
A		GRD	CKT
B		GRD	CKT

FEATURE OR OPTION	PROVIDE		
	FIG.	APP OR WIR	QUANTITY
AC-DC & RINGING SUPPLY WITH TOUCH-TONE DIAL TONE PROVIDED	1	W	1 PER CKT
-48V RECTIFIER	2		1 PER CKT
LOAD CAPACITOR	4		1 PER CKT



RECORD OF FIGURES, WIRING, AND APPARATUS CHANGES						
CHANGED ON ISS	IF JOB RECORDS DO NOT SPECIFY	THIS OPTION WAS FURN	SEE NOTE	USE IN CIRCUIT		
				STD	A&M	M.D.
4B	Z OR Y	Z		Y		Z
5D	W OR X	X		W		X
6B	U OR V	V		U		V
7B	T	NONE		T		

104. REMOVE LEAD FROM TERMINAL STRIP TO (J1) CONNECTOR FOR 756A PBX OPERATION.

(MFR DISC)

FEATURE OR OPTION	PROVIDE		
	FIG.	APP OR WIR	QUANTITY
AC-DC & RINGING SUPPLY WITH LT2 FOR DIAL TONE	1	X	1 PER CKT
LOAD CAPACITOR	3		1 PER CKT

- EQUIPMENT NOTES:
- 201. WIRING NOT OTHERWISE SPECIFIED SHALL BE 22GA KS-13385, SOLID. LEADS OVER 20GA SHALL BE KS-13385, STRANDED.
 - 202. THE 404C TONE GENERATOR IS MOUNTED ON SLIDE 1, MOUNTING POSITION A.

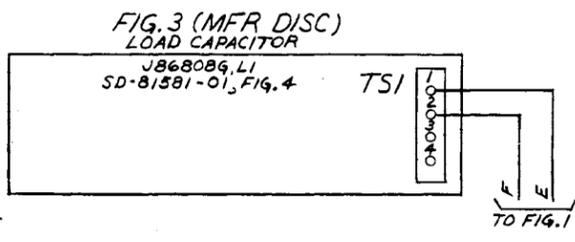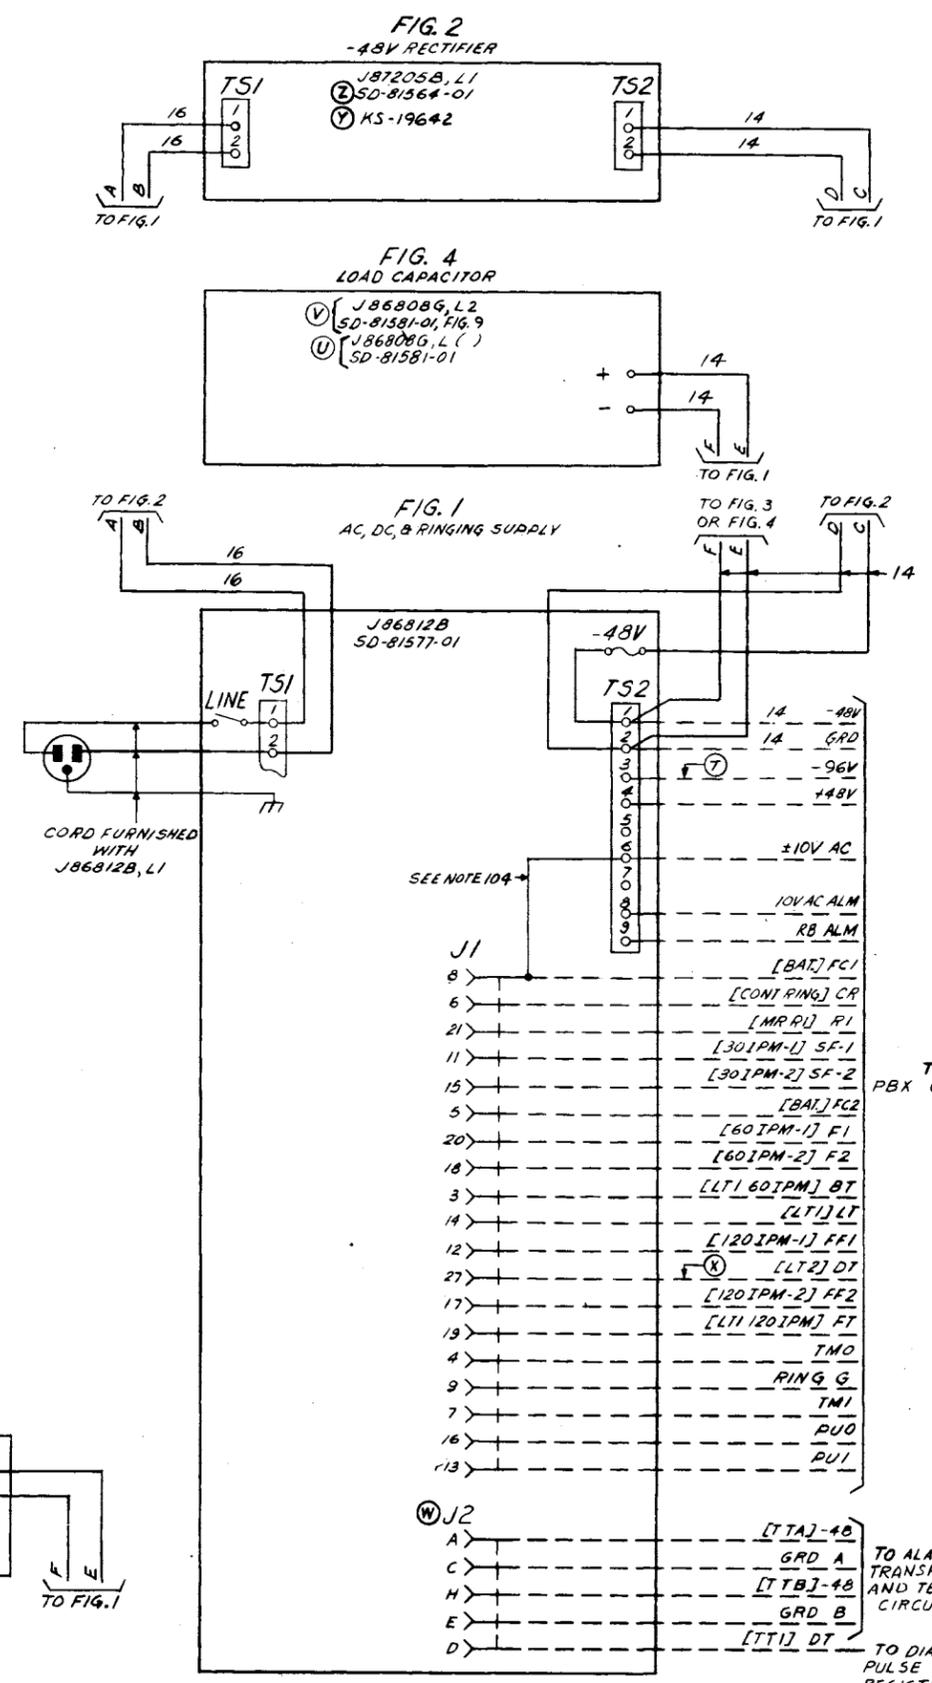

PARTIALLY REPLACES SD-81326-01

SD-81600-01

POWER SYSTEMS
 POWER SUPPLY CIRCUIT
 AC, DC & RINGING SUPPLY
 FOR 756A BATTERYLESS PBX
 J86464L

AT&T CO
 STANDARD

SD-81600-01

BELL TELEPHONE LABORATORIES
 INCORPORATED